



www.tuv.com

<p><b>TEST REPORT</b>  <b>IEC 62109-2</b>  <b>Safety of power converters for use in photovoltaic power systems –</b>  <b>Part2: Particular requirements for inverters</b></p>	
Report Reference No. ....	50145305 001 attachment 1.
Tested by (name + signature) .....	See cover page .....
Witnessed by (name + signature) ..	N/A .....
Supervised by (name + signature) ..	N/A .....
Approved by (name + signature) ....	See cover page .....
Date of issue.....	See cover page
Testing Laboratory.....	TÜV Rheinland (Shanghai) Co., Ltd.
Address .....	B1-13/F, No.177, Lane 777, West Guangzhong Road, Zhabei District, Shanghai 200072, P. R. China
Testing location/ procedure .....	CBTL <input type="checkbox"/> TMP <input type="checkbox"/> WMT <input type="checkbox"/> SMT <input type="checkbox"/> RMT <input type="checkbox"/> CCATL <input checked="" type="checkbox"/>
Testing location/ address .....	See cover page
Applicant's name .....	See cover page
Address .....	See cover page
Test specification:	
Standard .....	IEC/EN 62109-2: 2011
Test procedure .....	TÜV Bauart
Non-standard test method.....:	N/A
Test Report Form No.....	IEC 62109-2: 2011
Test Report Form(s) Originator .....	TÜV Rheinland Group
Master TRF .....	2011-08
<p><b>Copyright © 2006 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.</b></p> <p><b>This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.</b></p>	
Test item description .....	See report 50145305 001.
Trade Mark .....	See report 50145305 001.
Manufacturer .....	See report 50145305 001.
Model/Type reference.....	See report 50145305 001.
Ratings .....	See report 50145305 001.

<b>Testing procedure and testing location:</b>
<input type="checkbox"/> <b>CB Testing Laboratory:</b> Testing location/ address..... :
<input type="checkbox"/> <b>Associated CB Test Laboratory:</b> Testing location/ address..... : Tested by (name + signature) ..... : See cover page  Approved by (+ signature)..... : See cover page
<input type="checkbox"/> Testing procedure: TMP Tested by (name + signature) ..... : Approved by (+ signature)..... : Testing location/ address..... :
<input type="checkbox"/> Testing procedure: WMT Tested by (name + signature) ..... : Witnessed by (+ signature) ..... : Approved by (+ signature)..... : Testing location/ address..... :
<input type="checkbox"/> Testing procedure: SMT Tested by (name + signature) ..... : Approved by (+ signature)..... : Supervised by (+ signature) ..... : Testing location/ address..... :
<input type="checkbox"/> Testing procedure: RMT Tested by (name + signature) ..... : Approved by (+ signature)..... : Supervised by (+ signature) ..... : Testing location/ address..... :

**List of Attachments (including a total number of pages in each attachment):**

See report 50145305 001.

**Summary of testing****Tests performed (name of test and test clause):**

The critical tests were performed for this equipment included clauses 4.4.4.15.1, 4.4.4.15.2, 4.8.2.1, 4.8.3.5.2, 4.8.3.5.3 in scope of this standard.

**Testing location:**

The laboratory described on cover page.

**Summary of compliance with National Differences**

List of countries addressed: None.

The product fulfils the requirements of EN 62109-2: 2011.

**Copy of marking plate:**

See report 50145305 001.

Equipment mobility .....	<input type="checkbox"/> movable	<input type="checkbox"/> hand-held
	<input type="checkbox"/> stationary	<input checked="" type="checkbox"/> fixed (Wall mounted)
Connection to the mains.....	<input type="checkbox"/> pluggable equipment	<input type="checkbox"/> direct plug-in
	<input checked="" type="checkbox"/> permanent connection	<input type="checkbox"/> for building-in
Environmental category.....	<input checked="" type="checkbox"/> outdoor	<input type="checkbox"/> indoor conditional
		<input type="checkbox"/> indoor unconditional
Operating condition .....	<input checked="" type="checkbox"/> continuous	<input type="checkbox"/> short-time
		<input type="checkbox"/> intermittent
Over voltage category mains.....	<input type="checkbox"/> OVC I	<input type="checkbox"/> OVC II
	<input checked="" type="checkbox"/> OVC III	<input type="checkbox"/> OVC IV
Over voltage category PV.....	<input type="checkbox"/> OVC I	<input checked="" type="checkbox"/> OVC II
	<input type="checkbox"/> OVC III	<input type="checkbox"/> OVC IV
Mains supply tolerance (%).....	According to specified supply range	
Tested for IT power systems .....	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
IT testing, phase-phase voltage (V) .....	N/A	
Class of equipment .....	<input checked="" type="checkbox"/> Class I	<input type="checkbox"/> Class II
	<input type="checkbox"/> Class III	<input type="checkbox"/> Not classified
Mass of equipment (kg).....	See model list	
Pollution degree .....	<input type="checkbox"/> PD 1	<input checked="" type="checkbox"/> PD 2 (inside) <input checked="" type="checkbox"/> PD 3 (outside)
IP protection class .....	IP65	

**Possible test case verdicts:**

- test case does not apply to the test object.....: N/A
- test object does meet the requirement.....: Pass (P)
- test object does not meet the requirement.....: Fail (F)

**Testing:**

- Date of receipt of test items .....
  - Date(s) of performance of tests .....
- See report 50145305 001
- See report 50145305 001

**General remarks:**

"(see Attachment #)" refers to additional information appended to the report.

"(see appended table)" refers to a table appended to the report.

The tests results presented in this report relate only to the object tested.

This report shall not be reproduced except in full without the written approval of the testing laboratory.

List of test equipment must be kept on file and available for review.

Additional test data and/or information provided in the attachments to this report.

Throughout this report a  comma /  **point** is used as the decimal separator.

Determination of the test results includes consideration of measurement uncertainty from the test equipment and methods.

**Manufacturer's Declaration per sub-clause 6.2.5 of IEC 60335-1:**

**The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided** :  Yes  Not applicable

**When differences exist; they shall be identified in the General product information section.**

**Name and address of factory (ies)** : See report 50145305 001

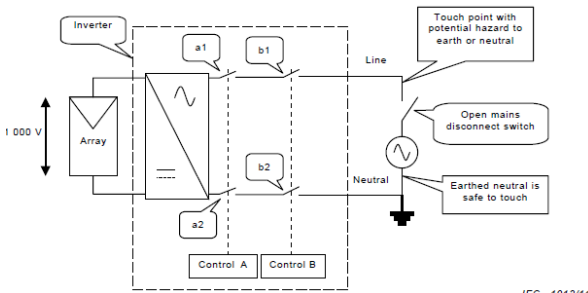
**General product information:**

See report 15083814 001.

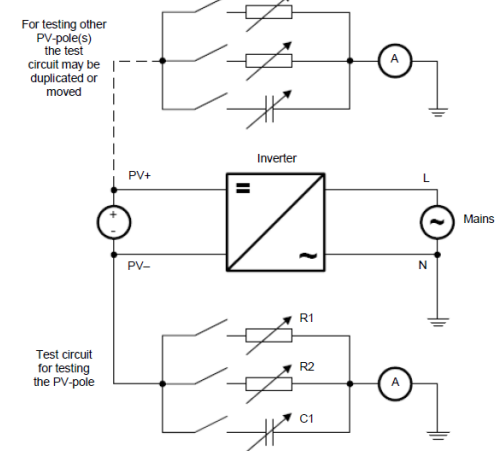
Throughout the test report following abbreviations may be used:

- input	i/p	- Test repeated, similar result(3 times)	TRSR
- output	o/p	- No indication of dielectric breakdown	NB
- short-circuited	s-c	- Cheesecloth remained intact	NC
- overloaded	o-l	- Tissue paper remained intact	NT
- open-circuited	o-c	- No hazards	NH
- normal conditions	N.C.	- The PCE can recover to operate automatically after removing the abnormal condition	RO
- single fault conditions	SFC	- functional insulation	FI
- between parts of opposite polarity	BOP	- basic insulation	BI
- internal protection operated	IPO	- supplementary insulation	SI
- Component damage (list damaged component)	CD	- double insulation	DI
- No component damaged	NCD	- reinforced insulation	RI

Indicate used abbreviations (if any)

IEC 62109-2: 2011			
Clause	Requirement – Test	Result - Remark	Verdict
4	General testing requirements <i>This clause of Part 1 is applicable with the following exceptions:</i>		P
4.4	Testing in SINGLE FAULT CONDITIONS		P
4.4.4	SINGLE FAULT CONDITIONS to be applied: <i>Additional subclauses:</i>	The PCE could detect and indicate the fault condition and disconnect from or not connect to the grid in case of single fault condition. Refer to the appended table 4.4 of IEC/EN 62109-1 test report 50145305 001.	P
4.4.4.15	Fault-tolerance of protection for GRID-INTERACTIVE INVERTERS		P
4.4.4.15.1	Fault-tolerance of residual current monitoring		P
4.4.4.15.2	Fault-tolerance of automatic disconnecting means		P
4.4.4.15.2.1	General		P
4.4.4.15.2.2	Design of insulation or separation   Figure 20 – Example system discussed in Note 2 above		P
4.4.4.15.2.3	Automatic checking of the disconnect means		P
4.4.4.16	Stand-alone inverters-load transfer test	Grid-connected PV Inverter.	N/A
4.4.4.17	Cooling system failure – Blanketing test	Enclosure: 79.5 °C	P
4.7	Electrical Ratings Tests <i>Additional subclauses:</i>	Refer to the appended table 4.7 of IEC/EN 62109-1 test report 50145305 001.	P
4.7.3	Measurement requirements for AC output ports for stand-alone inverters	Grid-connected PV Inverter.	N/A
4.7.4	Stand-alone Inverter AC output voltage and frequency	Grid-connected PV Inverter.	N/A
4.7.4.1	General		N/A

IEC 62109-2: 2011			
Clause	Requirement – Test	Result - Remark	Verdict
4.7.4.2	Steady state output voltage at nominal DC input		N/A
4.7.4.3	Steady state output voltage across the DC input range		N/A
4.7.4.4	Load step response of the output voltage at nominal DC input		N/A
4.7.4.5	Steady state output frequency		N/A
4.7.5	Stand-alone inverter output voltage waveform		N/A
4.7.5.1	General		N/A
4.7.5.2	Sinusoidal output voltage waveform requirements		N/A
4.7.5.3	Non-sinusoidal output waveform requirements		N/A
4.7.5.3.1	General		N/A
4.7.5.3.2	Total harmonic distortion		N/A
4.7.5.3.3	Waveform slope		N/A
4.7.5.3.4	Peak voltage		N/A
4.7.5.4	Information requirements for non-sinusoidal waveforms		N/A
4.7.5.5	Output voltage waveform requirements for inverters for dedicated loads		N/A
4.8	Additional tests for grid-interactive inverters	See below.	P
4.8.1	General requirements regarding inverter isolation and array grounding	Non-isolated inverters for ungrounded arrays.	P
4.8.2	Array insulation resistance detection for inverters for ungrounded and functionally grounded arrays	See below.	P
4.8.2.1	Array insulation resistance detection for inverters for ungrounded arrays	Inverter indicated the insulation fault and didn't connect to the grid when a resistor below 150 kΩ (required above 33 kΩ) linked between PV+/- to earth.	P
4.8.2.2	Array insulation resistance detection for inverters for functionally grounded arrays	See above.	N/A
4.8.3	Array residual current detection		P
4.8.3.1	General		P
4.8.3.2	30mA touch current type test for isolated inverters	See appended table.	P
4.8.3.3	Fire hazard residual current type test for isolated inverters	See appended table.	N/A
4.8.3.4	Protection by application of RCD's	The RCD provided integral to the inverter	P

IEC 62109-2: 2011											
Clause	Requirement – Test	Result - Remark	Verdict								
4.8.3.5	Protection by residual current monitoring		P								
4.8.3.5.1	General	See below.	P								
	Table 31 – Response time limits for sudden changes in residual current <table border="1" data-bbox="395 609 975 875"> <thead> <tr> <th>Residual current sudden change</th> <th>Max. time to inverter disconnection from the mains</th> </tr> </thead> <tbody> <tr> <td>30 mA</td> <td>0,3 s</td> </tr> <tr> <td>60 mA</td> <td>0,15 s</td> </tr> <tr> <td>150 mA</td> <td>0,04 s</td> </tr> </tbody> </table> NOTE These values of residual current and time are based on the RCD standard IEC61008-1.	Residual current sudden change	Max. time to inverter disconnection from the mains	30 mA	0,3 s	60 mA	0,15 s	150 mA	0,04 s	See appended table.	P
Residual current sudden change	Max. time to inverter disconnection from the mains										
30 mA	0,3 s										
60 mA	0,15 s										
150 mA	0,04 s										
	 <p>For testing other PV-pole(s) the test circuit may be duplicated or moved</p> <p>For the continuous residual current test, R1 establishes a baseline current just below the trip point, and R2 is switched in to cause the current to exceed the trip point. Capacitor C1 is not used.</p> <p>For the sudden change residual current test, C1 establishes a baseline current and R1 or R2 is switched in to cause the desired value of sudden change. The other resistor is not used.</p> <p>IEC 1013/11</p> <p>Figure 21 – Example test circuit for residual current detection testing</p>	See appended table.	P								
4.8.3.5.2	Test for detection of excessive continuous residual current	See appended table.	P								
4.8.3.5.3	Test for detection of sudden changes in residual current	See appended table.	P								
4.8.3.6	Systems located in closed electrical operating areas	Not specified to be located in closed electrical operating area.	N/A								
5	Marking and documentation <i>This clause of Part 1 is applicable with the following exceptions:</i>	See report 50145305 001.	P								



IEC 62109-2: 2011			
Clause	Requirement – Test	Result - Remark	Verdict
5.1	Marking		P
5.1.4	Equipment ratings <i>Replacement:</i>		P
5.2	Warning markings		P
5.2.2	Content for warning markings		P
5.2.2.6	Inverters for closed electrical operating areas		P
5.3	Documentation		P
5.3.2	Information related to installation <i>Additional subclauses:</i>		P
5.3.2.1	Ratings		P
5.3.2.2	Grid-interactive inverter setpoints	No adjustable setting available. Only the factory default values, however the adjustment shall be performed by distribution network operator.	N/A
5.3.2.3	Transformers and isolation	Transformerless PCE.	N/A
5.3.2.4	Transformers required but not provided	Transformerless PCE	N/A
5.3.2.5	PV modules for non-isolated inverters		P
5.3.2.6	Non-sinusoidal output waveform information	Grid-connection inverter.	N/A
5.3.2.7	Systems located in closed electrical operating areas	Not specified to be located in closed electrical operating area.	N/A
5.3.2.8	Stand- alone inverter output circuit bonding	Grid-connection inverter.	N/A
5.3.2.9	Protection by application of RCD's	Integrated RCM provided in inverter.	N/A
5.3.2.10	Remote indication of faults	The instructions are specified in section of "Connecting Communications Cables" in the user's manual.	P
5.3.2.11	External array insulation resistance measurement and response	Subclause 4.8.2.1 compliance.	N/A
5.3.2.12	Array functional grounding information	No such requirements.	N/A
5.3.2.13	Stand-alone inverters for dedicated loads	Grid-connection inverter.	N/A
5.3.2.14	Identification of firmware version(s)	The firmware version is displayed on LCD display panel and disclosed by communication interface.	P

IEC 62109-2: 2011			
Clause	Requirement – Test	Result - Remark	Verdict
6	Environmental requirements and conditions <i>This clause of Part 1 is applicable.</i>		P
7	Protection against electric shock and energy hazards <i>This clause of Part 1 is applicable except for the following additions:</i>	See report 50145305 001.	P
7.3	Protection against electric shock <i>Additional subclauses:</i>		P
7.3.10	Additional requirements for stand-alone inverters	Grid-connection inverter	N/A
	Stand-alone inverter output circuit bonding		N/A
	Stand-alone inverter isolation and protection of DVC-A circuits		N/A
7.3.11	Functionally grounded arrays		N/A
8	Protection against mechanical hazards <i>This clause of Part 1 is applicable.</i>	See report 50145305 001.	P
9	Protection against fire hazards <i>This clause of Part 1 is applicable with the following exceptions:</i>	See report 50145305 001.	P
9.3	Short-circuit and overcurrent protection <i>Additional subclause:</i>		P
9.3.4	Inverter backfeed current onto the array		P
10	Protection against sonic pressure hazards <i>This clause of Part 1 is applicable</i>	See report 50145305 001.	P
11	Protection against liquid hazards <i>This clause of Part 1 is applicable</i>	See report 50145305 001.	P
12	Protection against chemical hazards <i>This clause of Part 1 is applicable</i>	See report 50145305 001.	P
13	Physical requirements <i>This clause of Part 1 is applicable with the following exception:</i> <i>Additional subclause:</i>	See report 50145305 001.	P

IEC 62109-2: 2011			
Clause	Requirement – Test	Result - Remark	Verdict
13.9	Fault indication		P
	a) a visible or audible indication, integral to the inverter, and detectable from outside the inverter, and	LCD panel is available for fault indication.	P
	b) an electrical or electronic indication that can be remotely accessed and used.	The error message also can be remotely accessed and used	P
14	Components <i>This clause of Part 1 is applicable</i>	See report 50145305 001.	P

4.8.2.1	TABLE: Insulation resistance measurement				P
Conditions	Measurement [I.F. / N.O.]				Identification
	PV / DC Supply Voltage [Vdc]				
	250	500	800	960	
PV+ to PE: <u>130</u> [kΩ]	I.F.	I.F.	I.F.	I.F.	I.F.: Isolation Fault N.O.: Normal Operation
PV- to PE: <u>130</u> [kΩ]	I.F.	I.F.	I.F.	I.F.	
PV+ to PE: <u>150</u> [kΩ]	N.O.	N.O.	N.O.	N.O.	
PV- to PE: <u>150</u> [kΩ]	N.O.	N.O.	N.O.	N.O.	
PV+ to PE: <u>170</u> [kΩ]	N.O.	N.O.	N.O.	N.O.	
PV- to PE: <u>170</u> [kΩ]	N.O.	N.O.	N.O.	N.O.	
<p>Note:</p> <p>Array Insulation Resistance Threshold Value <math>R = 150</math> [kΩ] (Should be larger than <math>R = V_{MAX PV} / 30mA</math>.)</p> <p>The accuracy of resistance measurement <math>\Delta R = 15</math> [kΩ] (the value declared by manufacturer)</p>					

4.8.3.2, 4.8.3.3	TABLE: Touch current and fire hazard residual current measurement				N/A
Condition	PV power supply " + " → terminal A [mA]	PV power supply " - " → terminal A [mA]	Limit [mA]	Comments	
Condition	PV power supply " + " → earthing [mA]	PV power supply " - " → earthing [mA]	Limit [mA]	Comments	
<p>Note:</p> <p>Using measurement circuit of IEC 60990 figure 4 for testing touch current.</p> <p>Using ammeter for testing fire hazard residual current.</p>					

4.8.3.5.1	TABLE: Residual current monitoring test		P
Conditions	Steadily Residual current threshold value		
	Measurement [mA]	Limit [mA]	
	$U_N$		

PV+ to Neutral	235.0	300
	238.0	300
	234.0	300
	248.0	300
	240.0	300
PV- to Neutral	242.0	300
	238.0	300
	241.0	300
	244.0	300
	240.0	300
Note: 100% output power and Vmppmax input voltage		

4.8.3.5.1	TABLE: Residual current monitoring test	P
Conditions	Steadily Residual current threshold value	
	Measurement [ms]	Limit [ms]
	$U_N$	
PV+ to Neutral	233.5	300
	269.5	300
	272.5	300
	227.5	300
	228.0	300
PV- to Neutral	224.0	300
	225.0	300
	232.5	300
	240.5	300
	225.5	300
Note: 100% output power and Vmppmax input voltage		

4.8.3.5.1	TABLE: Residual current monitoring test	P
Conditions	Trigger disconnection maximum time	
	Measurement [ms]	Limit [ms]
	$U_N$	
Sudden residual current $\geq 30\text{mA}$		

PV+ to Neutral	234.0	300
	217.0	300
	214.0	300
	214.0	300
	225.0	300
PV- to Neutral	218.0	300
	234.5	300
	219.5	300
	222.0	300
	227.0	300
Sudden residual current $\geq 60\text{mA}$		
PV+ to Neutral	121.5	150
	129.5	150
	124.5	150
	132.0	150
	135.5	150
PV- to Neutral	121.8	150
	108.6	150
	123.4	150
	115.4	150
	135.2	150
Sudden residual current $\geq 150\text{mA}$		
PV+ to Neutral	25.8	40
	38.4	40
	36.8	40
	29.6	40
	26.8	40
PV- to Neutral	24.7	40
	38.4	40
	37.8	40
	32.8	40
	32.4	40
Note: 100% output power and $V_{\text{mppmax}}$ input voltage		

- End of test report -