






中国认可
国际互认
检测
TESTING
CNAS L0220

Test Report issued under the responsibility of:



TEST REPORT IEC 62109-2 Safety of Power Converter for use in Photovoltaic Power Systems Part 2: Particular requirements for inverters	
Report Number	201015063GZU-002
Date of issue	23 Nov 2020
Total number of pages.....	30 pages
Name of Testing Laboratory preparing the Report.....	Intertek Testing Services Shenzhen Ltd. Guangzhou Branch Room 02, & 101/E201/E301/E401/E501/E601/E701/E801 of Room 01 1-8/F., No. 7-2. Caipin Road, Science City, GETDD, Guangzhou, Guangdong, China
Applicant's name.....	Shenzhen SOFARSOLAR Co., Ltd.
Address	401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community, XinAn Street, BaoAn District, Shenzhen, China
Test specification:	
Standard	IEC/EN 62109-2:2011
Test procedure	CE
Non-standard test method.....	N/A
Test Report Form No.....	IEC62109_2B
Test Report Form(s) Originator	LCIE - Laboratoire Central des Industries Electriques
Master TRF.....	Dated 2016-11
Copyright © 2016 IEC System of Conformity Assessment Schemes for Electrotechnical Equipment and Components (IECEE System). All rights reserved. This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context. If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed. This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.	
General disclaimer:	
The test results presented in this report relate only to the object tested. This report shall not be reproduced, except in full, without the written approval of the Issuing CB Testing Laboratory. The authenticity of this Test Report and its contents can be verified by contacting the NCB, responsible for this Test Report.	





Test item description	Hybrid inverter
Trade Mark	
Manufacturer	Same as applicant
Model/Type reference	HYD 6000-EP, HYD 5500-EP, HYD 5000-EP, HYD 4600-EP, HYD 4000-EP, HYD 3680-EP, HYD 3000-EP
Ratings	See ratings in page 10-12 for details









Responsible Testing Laboratory (as applicable), testing procedure and testing location(s):		
<input checked="" type="checkbox"/>	Testing Laboratory:	Intertek Testing Services Shenzhen Ltd. Guangzhou Branch
	Testing location/ address	Block E, No.7-2 Guang Dong Software Science Park, Caipin Road, Guangzhou Science City, GETDD, Guangzhou, China
	Tested by (name, function, signature)	Jason Fu Supervisor 
	Approved by (name, function, signature) ..	Tommy Zhong Technical Manager 
<input type="checkbox"/>	Testing procedure: CTF Stage 1:	N/A
	Testing location/ address	N/A
	Tested by (name, function, signature)	N/A
	Approved by (name, function, signature) ..	N/A
<input type="checkbox"/>	Testing procedure: CTF Stage 2:	N/A
	Testing location/ address	N/A
	Tested by (name + signature)	N/A
	Witnessed by (name, function, signature) .	N/A
	Approved by (name, function, signature) ..	N/A
<input type="checkbox"/>	Testing procedure: CTF Stage 3:	N/A
<input type="checkbox"/>	Testing procedure: CTF Stage 4:	N/A
	Testing location/ address	N/A
	Tested by (name, function, signature)	N/A
	Witnessed by (name, function, signature) .	N/A
	Approved by (name, function, signature) ..	N/A
	Supervised by (name, function, signature) :	N/A



List of Attachments (including a total number of pages in each attachment): N/A	
Summary of testing:	
Tests performed (name of test and test clause): All applicable tests	Testing location: Intertek Testing Services Shenzhen Ltd. Guangzhou Branch Room 02, & 101/E201/E301/E401/E501/E601/E701/E801 of Room 01 1-8/F., No. 7-2. Caipin Road, Science City, GETDD, Guangzhou, Guangdong, China
Summary of compliance with National Differences (List of countries addressed): N/A	
<input checked="" type="checkbox"/> The product fulfils the requirements of IEC/EN 62109-2:2011	

Copy of marking plate:

The artwork below may be only a draft. The use of certification marks on a product must be authorized by the respective NCBs that own these marks.

			
Model No: HYD 6000-EP		Model No: HYD 5500-EP	
Max.DC Input Voltage	600V	Max.DC Input Voltage	600V
Operating MPPT Voltage Range	90V~580V	Operating MPPT Voltage Range	90V~580V
MAX.PV Isc	2x18A	MAX.PV Isc	2x18A
Battery Type	Lead-acid,Lithium-ion	Battery Type	Lead-acid,Lithium-ion
Battery Voltage Range	42-58V	Battery Voltage Range	42-58V
Max.Charging Current	100A	Max.Charging Current	100A
Max.Discharging Current	100A	Max.Discharging Current	100A
Max.Charging&Discharging Power	5000W	Max.Charging&Discharging Power	5000W
Nominal Grid Voltage	230Vac	Nominal Grid Voltage	230Vac
Nominal Output Voltage	230Vac	Nominal Output Voltage	230Vac
Max.Output Current	27.3A	Max.Output Current	25.0A
Nominal Grid Frequency	50/60Hz	Nominal Grid Frequency	50/60Hz
Power Factor	1 (adjustable+/-0.8)	Power Factor	1 (adjustable+/-0.8)
Nominal Output Power	6000W	Nominal Output Power	5000W
Backup Rated Current	22.7A	Backup Rated Current	22.7A
Backup Rated Apparent Power	5000VA	Backup Rated Apparent Power	5000VA
Ingress Protection	IP 65	Ingress Protection	IP 65
Operating Temperature Range	-30~+60°C	Operating Temperature Range	-30~+60°C
Protective Class	Class I	Protective Class	Class I
Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1		Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1	
			

			
Model No: HYD 5000-EP		Model No: HYD 4600-EP	
Max.DC Input Voltage	600V	Max.DC Input Voltage	600V
Operating MPPT Voltage Range	90V~580V	Operating MPPT Voltage Range	90V~580V
MAX.PV Isc	2x18A	MAX.PV Isc	2x18A
Battery Type	Lead-acid,Lithium-ion	Battery Type	Lead-acid,Lithium-ion
Battery Voltage Range	42-58V	Battery Voltage Range	42-58V
Max.Charging Current	100A	Max.Charging Current	100A
Max.Discharging Current	100A	Max.Discharging Current	100A
Max.Charging&Discharging Power	5000W	Max.Charging&Discharging Power	5000W
Nominal Grid Voltage	230Vac	Nominal Grid Voltage	230Vac
Nominal Output Voltage	230Vac	Nominal Output Voltage	230Vac
Max.Output Current	21.7A	Max.Output Current	20.9A
Nominal Grid Frequency	50/60Hz	Nominal Grid Frequency	50/60Hz
Power Factor	1(adjustable+/-0.8)	Power Factor	1(adjustable+/-0.8)
Nominal Output Power	5000W	Nominal Output Power	4600W
Backup Rated Current	22.7A	Backup Rated Current	20.9A
Backup Rated Apparent Power	5000VA	Backup Rated Apparent Power	4600VA
Ingress Protection	IP 65	Ingress Protection	IP 65
Operating Temperature Range	-30~+60°C	Operating Temperature Range	-30~+60°C
Protective Class	Class I	Protective Class	Class I
Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1		Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1	
			
			
Model No: HYD 4000-EP		Model No: HYD 3680-EP	
Max.DC Input Voltage	600V	Max.DC Input Voltage	600V
Operating MPPT Voltage Range	90V~580V	Operating MPPT Voltage Range	90V~580V
MAX.PV Isc	2x18A	MAX.PV Isc	2x18A
Battery Type	Lead-acid,Lithium-ion	Battery Type	Lead-acid,Lithium-ion
Battery Voltage Range	42-58V	Battery Voltage Range	42-58V
Max.Charging Current	85A	Max.Charging Current	80A
Max.Discharging Current	85A	Max.Discharging Current	80A
Max.Charging&Discharging Power	4250W	Max.Charging&Discharging Power	4000W
Nominal Grid Voltage	230Vac	Nominal Grid Voltage	230Vac
Nominal Output Voltage	230Vac	Nominal Output Voltage	230Vac
Max.Output Current	20.0A	Max.Output Current	16.0A
Nominal Grid Frequency	50/60Hz	Nominal Grid Frequency	50/60Hz
Power Factor	1(adjustable+/-0.8)	Power Factor	1(adjustable+/-0.8)
Nominal Output Power	4000W	Nominal Output Power	3680W
Backup Rated Current	18.2A	Backup Rated Current	13.6A
Backup Rated Apparent Power	4000VA	Backup Rated Apparent Power	3680VA
Ingress Protection	IP 65	Ingress Protection	IP 65
Operating Temperature Range	-30~+60°C	Operating Temperature Range	-30~+60°C
Protective Class	Class I	Protective Class	Class I
Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1		Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community,XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1,VDE-AR-N4105 G98,AS4777,UTE C15-712-1	
			

 Hybrid Inverter	
Model No:	HYD 3000-EP
Max.DC Input Voltage	600V
Operating MPPT Voltage Range	90V~580V
MAX.PV Isc	2x18A
Battery Type	Lead-acid, Lithium-ion
Battery Voltage Range	42-58V
Max.Charging Current	75A
Max.Discharging Current	75A
Max.Charging&Discharging Power	3750W
Nominal Grid Voltage	230Vac
Nominal Output Voltage	230Vac
Max.Output Current	15.0A
Nominal Grid Frequency	50/60Hz
Power Factor	1(adjustable+/-0.8)
Nominal Output Power	3000W
Backup Rated Current	13.6A
Backup Rated Apparent Power	3000VA
Ingress Protection	IP 65
Operating Temperature Range	-30~+60°C
Protective Class	Class I
Manufacturer : Shenzhen SOFARSOLAR Co., Ltd. Address : 401, Building 4, AnTongDa Industrial Park, District 68, XingDong Community, XinAn Street, BaoAn District, Shenzhen, China VDE0126-1-1, VDE-AR-N4105 G98, AS4777, UTE C15-712-1	
	

Note:

1. The above markings are the minimum requirements required by the safety standard. For the final production samples, the additional markings which do not give rise to misunderstanding may be added.
2. Label is attached on the side surface of enclosure and visible after installation.

Test item particulars	
Equipment mobility	<input type="checkbox"/> movable <input type="checkbox"/> hand-held <input type="checkbox"/> stationary <input checked="" type="checkbox"/> fixed <input type="checkbox"/> transportable <input type="checkbox"/> for building-in
Connection to the mains	<input type="checkbox"/> pluggable equipment <input type="checkbox"/> direct plug-in <input checked="" type="checkbox"/> permanent connection <input type="checkbox"/> for building-in
Environmental category	<input checked="" type="checkbox"/> outdoor <input type="checkbox"/> indoor unconditional <input type="checkbox"/> indoor conditional
Over voltage category Mains	<input type="checkbox"/> OVC I <input type="checkbox"/> OVC II <input checked="" type="checkbox"/> OVC III <input type="checkbox"/> OVC IV
Over voltage category PV	<input type="checkbox"/> OVC I <input checked="" type="checkbox"/> OVC II <input type="checkbox"/> OVC III <input type="checkbox"/> OVC IV
Mains supply tolerance (%)	-90 / +110 %
Tested for power systems	TN systems
IT testing, phase-phase voltage (V)	- - -
Class of equipment	<input checked="" type="checkbox"/> Class I <input type="checkbox"/> Class II <input type="checkbox"/> Class III <input type="checkbox"/> Not classified
Mass of equipment (kg)	Approx. 25Kg
Pollution degree	Outside PD3; Inside PD2
IP protection class	IP 65
.....	
Possible test case verdicts:	
- test case does not apply to the test object	N/A
- test object does meet the requirement	P (Pass)
- test object does not meet the requirement	F (Fail)
Testing	
Date of receipt of test item	15 Oct 2020
Date (s) of performance of tests	15 Oct 2020 – 21 Nov 2020
General remarks:	
"(See Enclosure #)" refers to additional information appended to the report. "(See appended table)" refers to a table appended to the report. Throughout this report a <input type="checkbox"/> comma / <input checked="" type="checkbox"/> point is used as the decimal separator. This report shall be used together with report No. 201015063GZU-001	
Manufacturer's Declaration per sub-clause 4.2.5 of IEC 60335-1:	

The application for obtaining a CB Test Certificate includes more than one factory location and a declaration from the Manufacturer stating that the sample(s) submitted for evaluation is (are) representative of the products from each factory has been provided

- Yes
- Not applicable

When differences exist; they shall be identified in the General product information section.

Name and address of factory (ies): Dongguan SOFAR SOLAR Co., Ltd .

1F-6F, Building E, No.1 JinQi Road, Bihu Industrial Park, Wulian Village, Fenggang Town, Dongguan City

General product information:

The unit is a single-phase hybrid inverter, it can convert the high PV voltage and Grid voltage to low DC for charge battery, also convert PV voltage and battery voltage to AC Grid.


The unit is providing EMI filtering at the PV and battery side. It does provide galvanic separation from PV side to Grid. The battery circuit does provide high frequency isolation to PV side and AC mains.

The unit has two controllers. the master DSP controller monitor the charge or discharge status; measure the PV voltage and current, battery current, bus voltage, AC voltage, current, GFCI and frequency.

The slave DSP controller monitor AC voltage, current, frequency, GFCI and communicate with the master controller

The master DSP and slave DSP are used together to control relay open or close, if the single fault on one DSP, the other one DSP can be capable to open the relay, so that still providing safety means

The topology diagram as following:

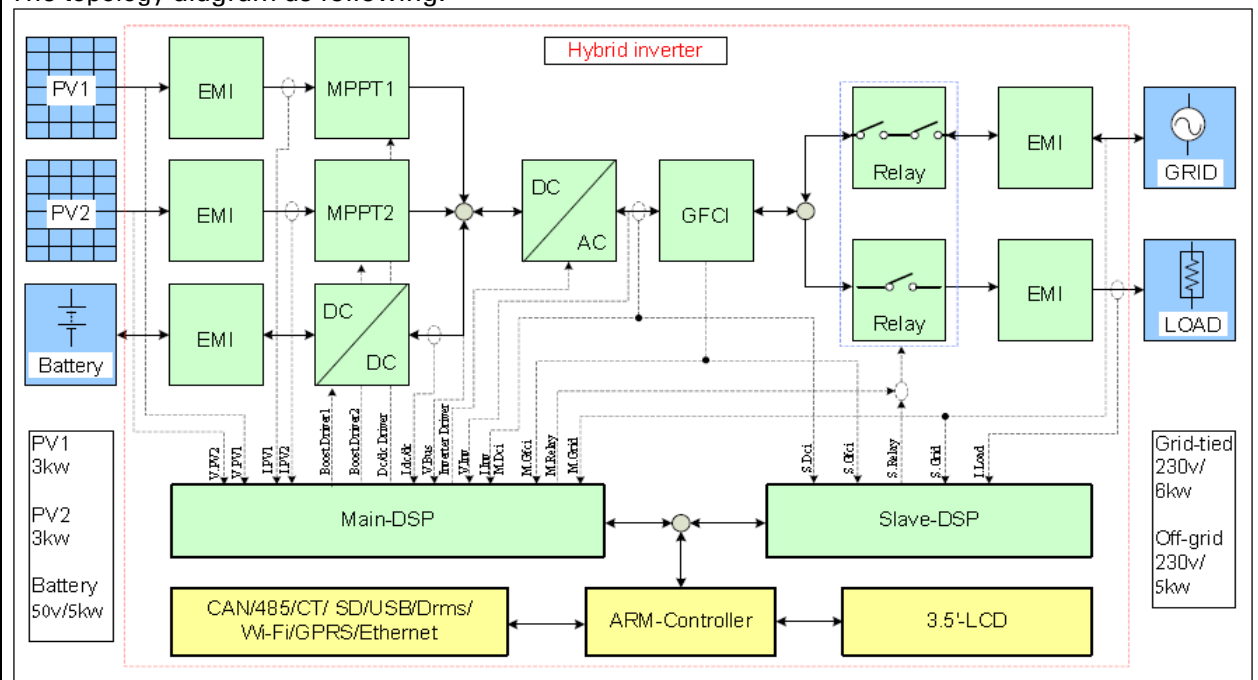

Model differences:

The models HYD 6000-EP, HYD 5500-EP, HYD 5000-EP, HYD 4600-EP, HYD 4000-EP, HYD 3680-EP, HYD 3000-EP are identical and only the output power derating in software. except for the following table.

Model	HYD 6000-EP	HYD 5500-EP	HYD 5000-EP	HYD 4600-EP	HYD 4000-EP	HYD 3680-EP	HYD 3000-EP
R332, R334, R336	0Ω, NC, 0Ω				NC, 0Ω, NC		
Bus capacitance	8pcs				6pcs		
INV inductor	0.75mH				1.035mH		
R123, R132	1.5KΩ, 1.5KΩ				499Ω, 499Ω		

The product was tested on:

The Software version: V02000

The Hardware version: V001

Other than special notes, typical model HYD 6000-EP used as representative for testing in this report.

Rating:

Model	HYD 3000-EP	HYD 3680-EP	HYD 4000-EP	HYD 4600-EP	HYD 5000-EP	HYD 5500-EP	HYD 6000-EP
Max. PV Input Voltage [d.c.V]	600						
MPPT operating voltage range [d.c.V]	90-580						
Number of MPP trackers	2						
Max. input current per MPPT [d.c.A]	13/13						
Max. PV Isc [d.c.A]	2 X 18						
Battery Type	Lead-acid, Lithium-ion						
Battery Voltage Range	42-58						

[d.c.V]							
Max. Charging Current [d.c.A]	75	80	85	100	100	100	100
Max. Discharging Current [d.c.A]	75	80	85	100	100	100	100
Max. Charging & Discharging Power [W]	3750	4000	4250	5000	5000	5000	5000
Nominal Grid voltage [a.c.V]	230						
Nominal Output Voltage (backup) [a.c.V]	230						
Max. output current [a.c.A]	15	16	20	20.9	21.7	25	27.3
Max AC current from utility grid [a.c.A]	27.3	32	36.4	41.8	43.4	43.4	54.6
Nominal Grid Frequency	50/60Hz						
Power Factor	1 (adjustable +/-0.8)						
Nominal AC power [W]	3000	3680	4000	4600	5000	5000	6000
Backup Max.current [a.c.A]	13.6	16.0	18.2	20.9	22.7	22.7	22.7
Backup Max. Apparent	3000	3680	4000	4600	5000	5000	5000

Power [VA]							
Ingress Protection	IP 65						
Protective Class	Class I						
Operating temperature range	-30 ~ +60°C						

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
4	GENERAL TESTING REQUIREMENTS		P
4.4.4	Single fault conditions to be applied		P
4.4.4.15	Fault-tolerance of protection for grid-interactive inverters		P
4.4.4.15.1	Fault-tolerance of residual current monitoring according to 4.8.3.5: the residual current monitoring system operates properly	See appended table 4.4.4.15.1	P
	a)..- The inverter ceases to operate		P
	- Indicates a fault in accordance with §13.9		P
	- Disconnect from the mains		P
	- not re-connect after any sequence of removing and reconnecting PV power		P
	- not re-connect after any sequence of removing and reconnecting AC power		P
	- not re-connect after any sequence of removing and reconnecting both PV and AC power		P
	b)..- The inverter continues to operate		N/A
	- the residual current monitoring system operates properly under single fault condition		N/A
	- Indicates a fault in accordance with §13.9		N/A
	c)..- The inverter continues to operate regardless of loss of residual current monitoring functionality		N/A
	- not re-connect after any sequence of removing and reconnecting PV power		N/A
	- not re-connect after any sequence of removing and reconnecting AC power		N/A
	- not re-connect after any sequence of removing and reconnecting both PV and AC power		N/A
	- Indicates a fault in accordance with §13.9		N/A
4.4.4.15.2	Fault-tolerance of automatic disconnecting means	Two series relays in each line and may independent operation for each relay.	P
4.4.4.15.2 .1	The means provided for automatic disconnection of a grid-interactive inverter from the mains shall:		P
	- disconnect all grounded current-carrying conductors from the mains	Disconnected all line conductors from the mains	P
	- disconnect all ungrounded current-carrying conductors from the mains		P
	- be such that with a single fault applied to the disconnection means or to any other location in the inverter, at least basic insulation or simple separation is maintained between the PV array and the mains when the disconnecting means is intended to be in the open state.	See appended table 4.4.4.15.2 Fault-tolerance of automatic disconnecting There are two relays in serial used as automatic disconnection means. Contact gap is >1.5 mm for each relay.	P
4.4.4.15.2 .2	Design of insulation or separation complies with requirements of 7.3.7 of Part 1: report here Part 1	The automatic disconnection means is automatically	P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	comment and verdict.	checked before the inverter start operation	
4.4.4.15.2.3	For non-isolated inverter, automatic checking of the isolation provided by a disconnect means after single fault.	See appended test table 4.4.4.15.2 Fault-tolerance of automatic disconnecting.	P
	If the check fail: - any still-functional disconnection means shall be left in the open position		P
	- at least basic or simple separation shall be maintained between the PV input and the mains		P
	- the inverter shall not start operation		P
	- the inverter shall indicate a fault in accordance with 13.9	The screen shown error information.	P
4.4.4.16	A stand-alone inverter with a transfer switch to transfer AC loads from the mains or other AC bypass source to the inverter output:		P
	- shall continue to operate normally		P
	- shall not present a risk of fire as the result of an out-of-phase transfer		P
	- shall not present a risk of shock as the result of an out-of-phase transfer		P
	- And having control preventing switching: components for malfunctioning		P
4.4.4.17	Cooling system failure – Blanketing test No hazards according to the criteria of sub-clause 4.4.3 of Part 1 shall result from blanketing the inverter This test is not required for inverters restricted to use only in closed electrical operating areas.	See appended test table Cooling system failure – Blanketing test.	P
	Test stop condition: time duration value or stabilized temperature		P
4.7	ELECTRICAL RATINGS TESTS		P
4.7.4	Stand-alone Inverter AC output voltage and frequency		P
4.7.4.1	General		P
4.7.4.2	Steady state output voltage at nominal DC input The steady-state AC output voltage shall not be less than 90 % or more than 110 % of the rated nominal voltage with the inverter supplied with its nominal value of DC input voltage.	See appended table.	P
4.7.4.3	Steady state output voltage across the DC input range The steady-state AC output voltage shall not be less than 85 % or more than 110 % of the rated nominal voltage with the inverter supplied with any value within the rated range of DC input voltage.	See appended table.	P
4.7.4.4	Load step response of the output voltage at nominal DC input The AC output voltage shall not be less than 85 % or more than 110 % of the rated nominal voltage for more than 1,5 s after application or removal of a resistive load.	See appended table.	P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
4.7.4.5	Steady state output frequency The steady-state AC output frequency shall not vary from the nominal value by more than +4 % or –6 %.		P
4.7.5	Stand-alone inverter output voltage waveform		P
4.7.5.1	General		P
4.7.5.2	The AC output voltage waveform of a sinusoidal output stand-alone inverter shall have a total harmonic distortion (THD) not exceeding of 10 % and no individual harmonic at a level exceeding 6 %.	See appended table	P
4.7.5.3	Non-sinusoidal output waveform requirements		N/A
4.7.5.3.1	General		N/A
4.7.5.3.2	The total harmonic distortion (THD) of the voltage waveform shall not exceed 40 %.		N/A
4.7.5.3.3	The slope of the rising and falling edges of the positive and negative half-cycles of the voltage waveform shall not exceed 10 V/μs measured between the points at which the waveform has a voltage of 10 % and 90 % of the peak voltage for that half-cycle.		N/A
4.7.5.3.4	The absolute value of the peak voltage of the positive and negative half-cycles of the waveform shall not exceed 1,414 times 110 % of the RMS value of the rated nominal AC output voltage.		N/A
4.7.5.4	Information requirements for non-sinusoidal waveforms The instructions provided with a stand-alone inverter not complying with 4.7.5.2 shall include the information in 5.3.2.6.		N/A
4.7.5.5	Output voltage waveform requirements for inverters for dedicated loads. For an inverter that is intended only for use with a known dedicated load, the following requirements may be used as an alternative to the waveform requirements in 4.7.5.2 to 4.7.5.3.		N/A
	The combination of the inverter and dedicated load shall be evaluated to ensure that the output waveform does not cause any hazards in the load equipment and inverter, or cause the load equipment to fail to comply with the applicable product safety standards.		N/A
	The inverter shall be marked with symbols 9 and 15 of Table C.1 of Part 1.		N/A
	The installation instructions provided with the inverter shall include the information in 5.3.2.13.		N/A
4.8	ADDITIONAL TESTS FOR GRID-INTERACTIVE INVERTERS		P
4.8.1	General requirements regarding inverter isolation and array grounding	Non-isolation inverter	N/A
	- Type of Array grounding supported		N/A
	- Inverter isolation		N/A
4.8.2	Array insulation resistance detection for inverters for ungrounded and functionally grounded arrays	(See attached table)	P
4.8.2.1	Array insulation resistance detection for inverters for ungrounded arrays		P
	Inverter shall have means to measure DC insulation		P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	resistance from PV input (array) to ground before starting operation		
	Or Inverter shall be provided with instruction in accordance with 5.3.2.11.	The inverter can measure DC insulation resistance from PV input array to ground before starting operation	N/A
	Measured DC insulation resistance:		P
	Inverter measurement circuit shall be capable of detecting insulation resistance below the limit value $R = V_{max}/30mA$ under normal conditions		P
	Inverter measurement circuit shall be capable of detecting insulation resistance below the limit value $R = V_{max}/30mA$ with ground fault in the PV array		P
	Isolated inverters shall indicate a fault if the insulation resistance is less than the limit value		N/A
	Isolated inverter fault indication maintained until insulation resistance has recovered to a value higher than the limit value		N/A
	Non-isolated inverters, or inverters with isolation not complying with the leakage current limits in the minimum inverter isolation requirements in Table 30:		P
	- shall indicate a fault in accordance with 13.9		P
	- shall not connect to the mains		P
4.8.2.2	Array insulation resistance detection for inverters for functionally grounded arrays		N/A
	a-1)The value of the total resistance, including the intentional resistance for array functional grounding, the expected insulation resistance of the array to ground, and the resistance of any other networks connected to ground (for example measurement networks) must not be lower than $R = (V_{MAX PV}/30 mA)$ ohms.		N/A
	a-2) The installation instructions shall include the information required in 5.3.2.12.		N/A
	b-1) As an alternative to a), or if a resistor value lower than in a) is used, the inverter shall incorporate means to detect, during operation, if the total current through the resistor and any networks (for example measurement networks) in parallel with it, exceeds the residual current values and times in Table 31		N/A
	b-2) Inverter shall either disconnect the resistor or limit the current by other means		N/A
	b-3) If the inverter is a non-isolated inverter, or has isolation not complying with the leakage current limits in the minimum inverter isolation requirements in Table 30, it shall also disconnect from the mains.		N/A
	c) The inverter shall have means to measure the DC insulation resistance from the PV input to ground before starting operation, in accordance with 4.8.2.1.		N/A
4.8.3	Array residual current detection		P
4.8.3.1	General		P
4.8.3.2	30 mA touch current type test for isolated inverters		N/A

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
4.8.3.3	Fire hazard residual current type test for isolated inverters		N/A
4.8.3.4	Protection by application of RCD's	Integrated RCM inside PCE	P
	- The requirement for additional protection in 4.8.3.1 can be met by provision of an RCD with a residual current setting of 30 mA, located between the inverter and the mains..		P
	- The selection of the RCD type to ensure compatibility with the inverter must be made according to rules for RCD selection in Part 1.		P
	- The RCD provided integral to the inverter, or		P
	- The RCD provided by the installer if details of the rating, type, and location for the RCD are given in the installation instructions per 5.3.2.9.		N/A
4.8.3.5	Protection by residual current monitoring		P
4.8.3.5.1	General		P
	Where required by Table 30, the inverter shall provide residual current monitoring that functions whenever the inverter is connected to the mains with the automatic disconnection means closed.		P
	The residual current monitoring means shall measure the total (both a.c. and d.c. components) RMS current.		P
	As indicated in Table 30 for different inverter types, array types, and inverter isolation levels, detection may be required for excessive continuous residual current, excessive sudden changes in residual current, or both, according to the following limits:		P
	a) Continuous residual current: The inverter shall disconnect within 0,3 s and indicate a fault in accordance with 13.9 if the continuous residual current exceeds:		P
	- maximum 300 mA for inverters with continuous output power rating ≤ 30 kV;		P
	- maximum 10 mA per kVA of rated continuous output power for inverters with continuous output power rating > 30 kVA.		N/A
	The inverter may attempt to re-connect if the array insulation resistance meets the limit in 4.8.2.		P
	b) Sudden changes in residual current: The inverter shall disconnect from the mains within the time specified in Table 31		P
	The inverter indicates a fault in accordance with 13.9, if a sudden increase in the RMS residual current is detected exceeding the value in the table.		P
	The inverter may attempt to re-connect if the array insulation resistance meets the limit in 4.8.2.		P
4.8.3.5.2	Test for detection of excessive continuous residual current: test repeated 5 times and time to disconnect shall not exceed 0,3 s.	See appended test table 4.8.3.5.2 Test for detection of excessive continuous residual current	P
4.8.3.5.3	Test for detection of sudden changes in residual current repeated 5 times and each of the 5 results shall not exceed the time limit indicated in for each row		P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	(30mA, 60mA and 150mA) of Table 31.		
4.8.3.6	Systems located in closed electrical operating areas		N/A
	The protection against shock hazard is not required if the installation information provided with the inverter indicates the restriction for use in a closed electrical operating area, and		N/A
	Installation information indicates what forms of shock hazard protection are and are not provided integral to the inverter, in accordance with 5.3.2.7.		N/A
	The inverter shall be marked as in 5.2.2.6.		N/A
5	MARKING AND DOCUMENTATION		P
5.1	Marking		P
5.1.4	Equipment ratings		P
	PV input ratings:	See below	P
	- V _{max} PV (absolute maximum) (d.c. V)	600 d.c. V	P
	- I _{sc} PV (absolute maximum) (d.c. A)	2x18 d.c. A	P
	a.c. output ratings:		P
	- Voltage (nominal or range) (a.c. V)	230a.c. V	P
	- Current (maximum continuous) (a.c. A)		P
	- Frequency (nominal or range) (Hz)	50Hz	P
	- Power (maximum continuous) (W or VA)		P
	- Power factor range	0.80 lead-0.80 lag	P
	a.c input ratings:		P
	- Voltage (nominal or range) (a.c. V)	230 a.c. V	P
	- Current (maximum continuous) (a.c. A)		P
	- Frequency (nominal or range) (Hz)	50Hz	P
	d.c input (other than PV) ratings:	External battery can provide dc voltage to PCE.	
	- Voltage (nominal or range) (d.c. V)	42-58d.c. V	
	- Current (maximum continuous) (d.c. A)	100d.c. A	
	d.c. output ratings:	For charging battery	P
	- Voltage (nominal or range) (d.c. V)	42-58d.c. V	P
	- Current (maximum continuous) (d.c. A)	100d.c. A	P
	Protective class (I or II or III)	Class I	P
	Ingress protection (IP) rating per part 1	IP 65	P
	An inverter that is adjustable for more than one nominal output voltage shall be marked to indicate the particular voltage for which it is set when shipped from the factory.		N/A
5.2	Warning markings		P
5.2.2	Content for warning markings		P
5.2.2.6	Inverters for closed electrical operating areas		N/A
	Where required by 4.8.3.6, an inverter not provided with full protection against shock hazard on the PV array shall be marked with a warning that the inverter is only for use in a closed electrical operating area, and referring to the installation instructions.		N/A

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
5.3	Documentation		P
5.3.2	Information related to installation		P
5.3.2.1	Ratings. Subclause 5.3.2 of Part 1 requires the documentation to include ratings information for each input and output. For inverters this information shall be as in Table 33 below. Only those ratings that are applicable based on the type of inverter are required.		P
	PV input quantities :		P
	- Vmax PV (absolute maximum) (d.c. V)		P
	- PV input operating voltage range (d.c. V)		P
	- Maximum operating PV input current (d.c. A)		P
	- Isc PV (absolute maximum) (d.c. A)		P
	- Isc PV (absolute maximum) (d.c. A)		P
	- Max. inverter backfeed current to the array (a.c. or d.c. A)		P
	a.c. output quantities:		P
	- Voltage (nominal or range) (a.c. V)		P
	- Current (maximum continuous) (a.c. A)		P
	- Current (inrush) (a.c. A, peak and duration)		P
	- Frequency (nominal or range) (Hz)		P
	- Power (maximum continuous) (W or VA)		P
	- Power factor range		P
	- Maximum output fault current (a.c. A, peak and duration or RMS)		P
	- Maximum output overcurrent protection (a.c. A)		P
	a.c. input quantities:		P
	- Voltage (nominal or range) (a.c. V)		P
	- Current (maximum continuous) (a.c. A)		P
	- Current (inrush) (a.c. A, peak and duration)		P
	- Frequency (nominal or range) (Hz)		P
	d.c input (other than PV) quantities:		P
	- Voltage (nominal or range) (d.c. V)		P
	- Nominal battery voltage (d.c. V)		P
	- Current (maximum continuous) (d.c. A)		P
	d.c. output quantities:		P
	- Voltage (nominal or range) (d.c. V)		P
	- Nominal battery voltage (d.c. V)		P
	- Current (maximum continuous) (d.c. A)		P
	Protective class (I or II or III)		P
	Ingress protection (IP) rating per part 1		P
5.3.2.2	Grid-interactive inverter setpoints		P
	For a grid-interactive unit with field adjustable trip points, trip times, or reconnect times, the presence of such controls, the means for adjustment, the factory default values, and the limits of the ranges of adjustability shall be provided in the documentation for the PCE or in other format such as on a website. Provided solution:	No adjustable setting available. Only the factory default values, but the adjustment can be set by authorized person	P
	The setting of field adjustable setpoints shall be accessible from the PCE		P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
5.3.2.3	Transformers and isolation		N/A
	whether an internal isolation transformer is provided, and if so, what level of insulation (functional, basic, reinforced, or double) is provided by that transformer. The instructions shall also indicate what the resulting installation requirements are regarding such things as earthing or not earthing the array, providing external residual current detection devices, etc.		N/A
	An inverter shall be provided with information to the installer regarding:		N/A
	- providing of internal isolation transformer		N/A
	- the level of insulation (functional, basic, reinforced, or double)		N/A
	The instructions shall also indicate what the resulting installation requirements are regarding:		N/A
	- earthing or not earthing the array		N/A
	- providing external residual current detection devices		N/A
	- requiring an external isolation transformer,		N/A
5.3.2.4	Transformers required but not provided		N/A
	An inverter that requires an external isolation transformer not provided with the unit, shall be provided with instructions that specify, and for the external isolation transformer with which it is intended to be used:		N/A
	- the configuration type		N/A
	- electrical ratings		N/A
	- environmental ratings		N/A
5.3.2.5	PV modules for non-isolated inverters		P
	Non-isolated inverters shall be provided with installation instructions that require PV modules that have an IEC 61730 Class A rating		P
	If the maximum AC mains operating voltage is higher than the PV array maximum system voltage then the instructions shall require PV modules that have a maximum system voltage rating based upon the AC mains voltage.		N/A
5.3.2.6	Non-sinusoidal output waveform information		N/A
	The instruction manual for a stand-alone inverter not complying with 4.7.5.2 shall include a warning that:		N/A
	- the waveform is not sinusoidal,		N/A
	- some loads may experience increased heating,		N/A
	- the user should consult the manufacturers of the intended load equipment before operating that load with the inverter		N/A
	The inverter manufacturer shall provide information regarding:		N/A
	- what types of loads may experience increased heating		N/A
	- recommendations for maximum operating times with such loads		N/A
	The inverter manufacturer shall specify for the waveforms as determined by the testing in 4.7.5.3.2 through 4.7.5.3.4.:		N/A
	- THD		N/A
	- slope		N/A

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- peak voltage		N/A
5.3.2.7	Systems located in closed electrical operating areas		N/A
	Where required by 4.8.3.6, an inverter not provided with full protection against shock hazard on the PV array shall be provided with installation instructions:		N/A
	- requiring that the inverter and the array must be installed in closed electrical operating areas		N/A
	- indicating which forms of shock hazard protection are and are not provided integral to the inverter (for example the RCD, isolation transformer complying with the 30 mA touch current limit, or residual current monitoring for sudden changes)		N/A
5.3.2.8	Stand-alone inverter output circuit bonding		P
	Where required by 7.3.10, the documentation for an inverter shall include the following:		P
	- if output circuit bonding is required but is not provided integral to the inverter, the required means shall be described in the installation instructions, including which conductor is to be bonded and the required current carrying capability or cross-section of the bonding means;		P
	- if the output circuit is intended to be floating, the documentation for the inverter shall indicate that the output is floating.		N/A
5.3.2.9	Protection by application of RCD's	Integrated RCM used inside	N/A
	Where the requirement for additional protection in 4.8.3.1 is met by requiring an RCD that is not provided integral to the inverter, as allowed by 4.8.3.4, the installation instructions shall state the need for the RCD,		N/A
	and shall specify its rating, type, and required circuit location		N/A
5.3.2.10	Remote indication of faults		P
	The installation instructions shall include an explanation of how to properly make connections to (where applicable), and use, the electrical or electronic fault indication required by 13.9.	The instructions are specified "Warning List" of the product manual.	P
5.3.2.11	External array insulation resistance measurement and response	Integrated resistance measurement inside	N/A
	The installation instructions for an inverter for use with ungrounded arrays that does not incorporate all the aspects of the insulation resistance measurement and response requirements in 4.8.2.1, must include:		N/A
	- for isolated inverters: an explanation of what aspects of array insulation resistance measurement and response are not provided, and		N/A
	- an instruction to consult local regulations to determine if any additional functions are required or not;		N/A
	- for non-isolated inverters: an explanation of what external equipment must be provided in the system, and		N/A
	- what the setpoints and response implemented by that equipment must be, and:		N/A

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	- how that equipment is to be interfaced with the rest of the system.		N/A
5.3.2.12	Array functional grounding information		N/A
	Where approach a) of 4.8.2.2 is used, the installation instructions for the inverter shall include all of the following:		N/A
	a) the value of the total resistance between the PV circuit and ground integral to the inverter		N/A
	b) the minimum array insulation resistance to ground that system designer or installer must meet when selecting the PV panel and system design, based on the minimum value that the design of the PV functional grounding in the inverter was based on		N/A
	c) the minimum value of the total resistance $R = V_{MAX} / 30 \text{ mA}$ that the system must meet, with an explanation of how to calculate the total		N/A
	d) a warning that there is a risk of shock hazard if the total minimum resistance requirement is not met.		N/A
5.3.2.13	Stand-alone inverters for dedicated loads		N/A
	Where the approach of 4.7.5.5 is used, the installation instructions for the inverter shall include a warning that the inverter is only to be used with the dedicated load for which it was evaluated, and shall specify the dedicated load.		N/A
5.3.2.14	Identification of firmware version(s)		P
	An inverter utilizing firmware for any protective functions shall provide means to identify the firmware version.		P
	This can be a marking, but the information can also be provided by a display panel, communications port or any other type of user interface.....	The firmware version is displayed on LCD display panel and disclosed by communication interface.	P
7	PROTECTION AGAINST ELECTRIC SHOCK AND ENERGY HAZARDS		P
7.3	Protection against electric shock		P
7.3.10	Additional requirements for stand-alone inverters		P
	One circuit conductor bonded to earth to create a grounded conductor and an earthed system.		P
	The means used to bond the grounded conductor to protective earth provided within the inverter or as part of the installation		P
	If not provided integral to the inverter, the required means shall be described in the installation instructions as per 5.3.2.8.		P
	The means used to bond the grounded conductor to protective earth shall comply with the requirements for protective bonding in Part 1,		P
	If the bond can only ever carry fault currents in stand-alone mode, the maximum current for the bond is determined by the inverter maximum output fault current.		P

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
	Output circuit bonding arrangements shall ensure that in any mode of operation, the system only has the grounded circuit conductor bonded to earth in one place at a time..		P
	Switching arrangements may be used, in which case the switching device used is to be subjected to the bond impedance test along with the rest of the bonding path		N/A
	Inverters intended to have a circuit conductor bonded to earth shall not impose any normal current on the bond except for leakage current.		P
	Outputs that are intentionally floating with no circuit conductor bonded to ground, must not have any voltages with respect to ground that are a shock hazard in accordance with Clause 7 of Parts 1 and 2.		N/A
	The documentation for the inverter shall indicate that the output is floating as per 5.3.2.8.		N/A
7.3.11	Functionally grounded arrays		N/A
	All PV conductors in a functionally grounded array shall be treated as being live parts with respect to protection against electric shock.		N/A
9	PROTECTION AGAINST FIRE HAZARDS		P
9.3	Short-circuit and overcurrent protection		P
9.3.4	Inverter backfeed current onto the array		P
	The backfeed current testing and documentation requirements in Part 1 apply, including but not limited to the following.		P
	Inverter backfeed current onto the PV array maximum value.....		P
	This inverter backfeed current value shall be provided in the installation instructions regardless of the value of the current, in accordance with Table 33.	No backfeed current that can flow out of the inverter PV input terminals.	P
13	PHYSICAL REQUIREMENTS		P
13.9	Fault indication		P
	Where this Part 2 requires the inverter to indicate a fault, both of the following shall be provided:		P
	a) a visible or audible indication, integral to the inverter, and detectable from outside the inverter, and		P
	b) an electrical or electronic indication that can be remotely accessed and used.		P
	The installation instructions shall include information regarding how to properly make connections (where applicable) and use the electrical or electronic means in b) above, in accordance with 5.3.2.10.		P

IEC 62109-2							
Clause	Requirement + Test					Result - Remark	Verdict
4.4.4	TABLE: Single fault condition to be applied						P
	Ambient temperature (°C)					25	—
	Power source for EUT: Manufacturer, model/type, output rating					--	—
4.4.4.15.1	Fault-tolerance of residual current monitoring						
Component No.	Fault	Supply voltage (V)	Test time	Fuse #	Fuse current (A)	Observation	
RCM/LP1 pin GND-Vout	Shorted	520	10 min	--	--	Output a.c. relays operated, disconnected with grid , error code "ID05" (GFCI fault). No hazards.	
C463	Shorted	520	10 min	--	--	Output a.c.relays operated, disconnected with grid. error code"GFCI fault" No damaged. No hazards.	
Check that the residual current monitoring operates properly					Yes		
Supplementary information:							

4.4.4	TABLE: Single fault condition to be applied						P
	Ambient temperature (°C)					25	—
	Power source for EUT: Manufacturer, model/type, output rating					--	—
4.4.4.15.2	Fault-tolerance of automatic disconnecting means						
Component No.	Fault	Supply voltage (V)	Test time	Fuse #	Fuse current (A)	Observation	
Relay RL4	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	
Relay RL1	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	
Relay RL2	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	

IEC 62109-2							
Clause	Requirement + Test					Result - Remark	Verdict
Relay RL5	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	
Q23 (Pin G-S)	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	
Q17 (Pin G-S)	Short circuit before energized	520	10 min	--	--	Indicate Relay fault, error code "ID41" (RecoverRelayFail). Do not connect to AC mainsn. No damage, no hazards.	
Check that the relays fulfil the basic insulation or simple separation based on the PV circuit working voltage.						There are two relays in serial used as automatic disconnection means. Contact gap is >1.5 mm for each relay.	
Each active phase can be switched. (L and N)						Yes	
Supplementary information:							

4.4.4.17	Cooling system failure – Blanketing test		P
	Test voltage (Vdc).....:	300 Vdc	—
	Test current (Idc)	14.0A	—
	Test voltage (Vac).....:	230Vac	—
	Test current (Iac)	17.4A	—
	t _{amb1} (°C)	45.2	—
	t _{amb2} (°C)	45.7	—
maximum temperature T of part/at::		T (°C)	T _{max} (°C)
Ambient temp.		45.2	--
Enclosure (Front)		50.3	90
Enclosure (Side)		46.4	90
Enclosure (Top)		59.5	90
Mounting surface		64.7	90
Supplementary information:			

IEC 62109-2				
Clause	Requirement + Test		Result - Remark	Verdict
4.7.4	TABLE: Steady state Inverter AC output voltage and frequency			P
	Nominal DC input (V)		90/300/520	
	Nominal output AC voltage (V) :		230V	
AC output U (V)	Frequency (Hz)	Condition/status	Comments	
233.2	50	Without load	90V input	
233.2	50	Without load	300V input	
233.2	50	Without load	520V input	
222.3	50	Resistive load application	90V input	
222.3	50	Resistive load application	300V input	
222.3	50	Resistive load application	520V input	
233.2	50	Resistive load removal	90V input	
233.2	50	Resistive load removal	300V input	
233.2	50	Resistive load removal	520V input	
Supplementary information:				

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict

4.8.2	TABLE: Array insulation resistance detection for inverters for ungrounded and functionally grounded arrays			P
4.8.2.1	Array insulation resistance detection for inverters for ungrounded arrays			P
DC Voltage below minimum operating voltage (V)	DC Voltage for inverter begin operation (V)	Resistance between ground and PV input terminal (Ω)	Required Insulation resistance $R = (V_{MAX\ PV} / 30mA)$ (Ω)	Result
DC+				
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
DC-				
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"

IEC 62109-2					
Clause	Requirement + Test			Result - Remark	Verdict
100V	120V	150kohm	20kohm	The PV inverter cannot start-up. Error message: "IsoFault"	
<p>Note:</p> <p>For isolated inverters, shall indicate a fault in accordance with 13.9 (operation is allowed); the fault indication shall be maintained until the array insulation resistance has recovered to a value higher than the limit above</p> <p>For non-isolated inverters, or inverters with isolation not complying with the leakage current limits in the minimum inverter isolation requirements in Table 30, shall indicate a fault in accordance with 13.9, and shall not connect to the mains; the inverter may continue to make the measurement, may stop indicating a fault and may connect to the mains if the array insulation resistance has recovered to a value higher than the limit above.</p> <p>It is not required to test all PV input terminals if analysis of the design indicates that one or more terminals can be expected to have the same result, for example where multiple PV string inputs are in parallel.</p> <p>Supplementary information:</p>					

4.8.3.2	TABLE: 30mA touch current type test for isolated inverters			N/A
Condition	Current (mA)		Limit (30mA)	
DC+ to PE				
DC- to PE				
<p>Supplementary information:</p> <p>The touch current measurement circuit of IEC 60990, Figure 4 is connected from each terminal of the array to ground, one at a time.</p>				

4.8.3.3	TABLE: Fire hazard residual current type test for isolated inverters			N/A
Condition	Current (mA)		Limit (300mA or 10mA per kVA)	
DC+ to PE				
DC- to PE				
<p>Supplementary information:</p>				

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict

4.8.3.5	TABLE: Protection by residual current monitoring		P
Test conditions:		Output power (kVA) : 6.0 Input voltage (V _{DC}): 520 Frequency (Hz):50 Output AC Voltage (V _{AC}):230	
4.8.3.5.2	Test for detection of excessive continuous residual current		P
Fault Current (mA)		Disconnection time (ms)	
Measured Fault Current	Limit 300mA for output power ≤ 30 kVA 10mA per kVA for output power > 30 kVA	Measured Disconnection time	Limit
+ PV to N:			
247.4	300	246.0	300
247.9	300	254.0	300
247.1	300	244.0	300
241.8	300	242.0	300
252.3	300	256.0	300
- PV to N:			
236.8	300	234.0	300
237.9	300	260.0	300
242.8	300	230.0	300
234.8	300	232.0	300
242.5	300	244.0	300
<p>Note:</p> <ul style="list-style-type: none"> – maximum 300mA for inverters with continuous output power rating ≤30 kVA; – maximum 10mA per kVA of rated continuous output power for inverters with continuous output power rating > 30 kVA. <p>This test shall be repeated 5 times, and for all 5 tests the time to disconnect shall not exceed 0,3s. The test is repeated for each PV input terminal. It is not required to test all PV input terminals if analysis of the design indicates that one or more terminals can be expected to have the same result, for example where multiple PV string inputs are in parallel.</p>			
Supplementary information:			

4.8.3.5.3	TABLE: Test for detection of sudden changes in residual current		P
+PV to N			
Limit (mA)	U _N		Limit (ms)
	Disconnection time (ms)		
30	214		300
30	230		300
30	224		300
30	208		300
30	228		300

IEC 62109-2			
Clause	Requirement + Test	Result - Remark	Verdict
60	118		150
60	128		150
60	105		150
60	121		150
60	133		150
150	32.0		40
150	26.0		40
150	35.8		40
150	36.4		40
150	30.8		40
-PV to N			
Limit (mA)	U _N		Limit (ms)
	Disconnection time (ms)		
30	206		300
30	226		300
30	234		300
30	218		300
30	212		300
60	110		150
60	123		150
60	131		150
60	125		150
60	129		150
150	27.0		40
150	21.8		40
150	29.0		40
150	34.0		40
150	24.0		40
<p>Note: The capacitive current is raised until disconnection. Test condition: $I_c + 30/60/150\text{mA} \leq I_{c\text{max}}$. R₁ is set that 30/60/150mA Flow and switch S is closed.</p>			
Supplementary information:			

(End of report)